


# Storm Surge Guidance: 26th Ward WWTP

If a storm surge advisory is announced as part of a weather report, locate the forecasted surge level below. Protective measures should be taken for all locations at or below that level. If a small craft advisory is also issued, waves may splash shoreline assets more than 3 ft above the surge level. Adjust protection accordingly.

Storm Surge Advisory\*      Floodplain and elevations      Elevations and areas to be protected  
Brooklyn Sewer Datum

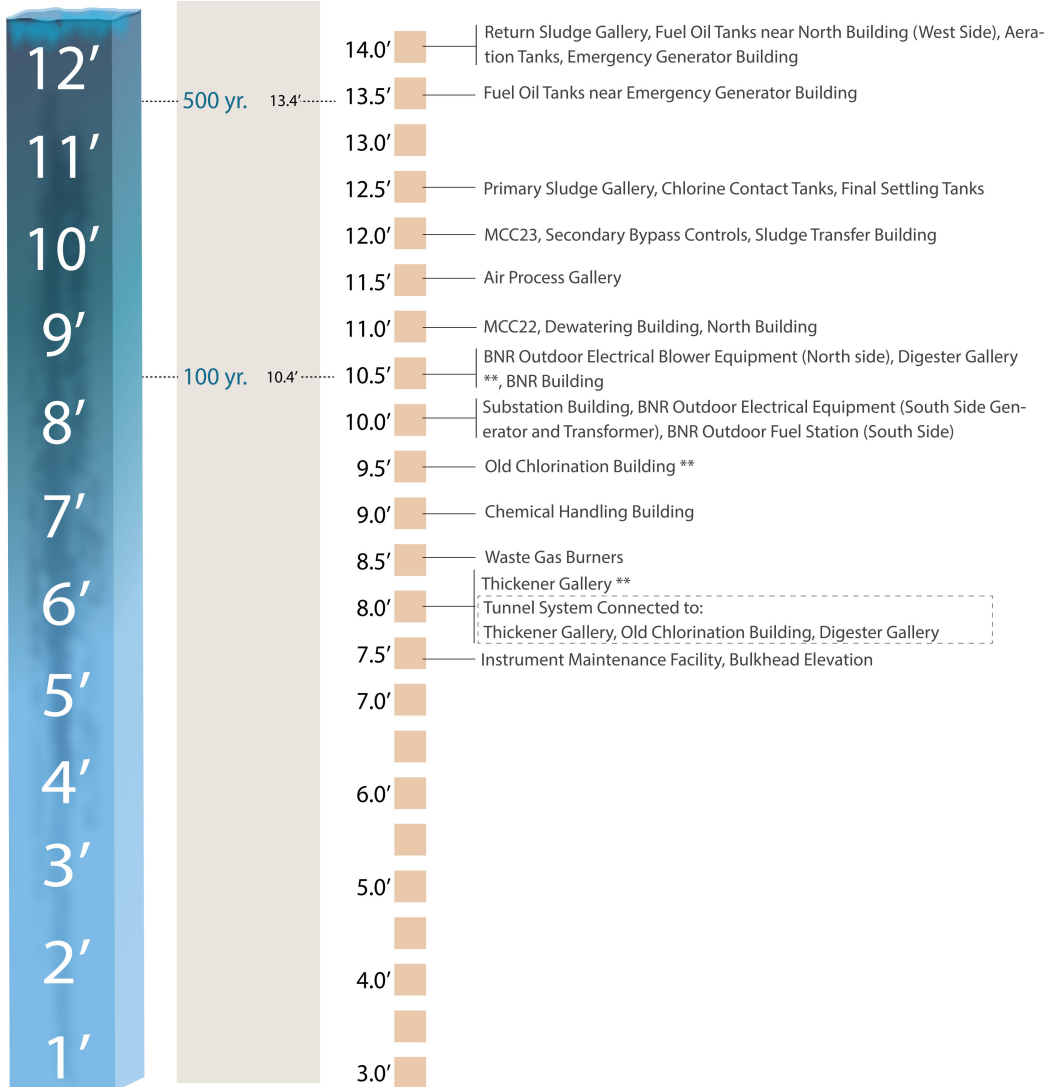

\*Storm surge added to Mean Higher High Water at Sandy Hook as of 2012, which is 1.77 ft Brooklyn Sewer Datum. Sea level is expected to rise up to 30 inches by 2050. This storm surge advisory is for current conditions.  
\*\*One of the multiple flood pathways into the tunnel system. To protect tunnels, ensure all pathways are protected.

This storm surge placard provides a quick reference for operators to prepare their plant in advance of a surge event. The guidance enables an operator to rapidly locate at-risk locations based on storm surge warnings. Once at-risk areas are identified, plant staff may proactively protect locations at or below the forecasted surge levels.